



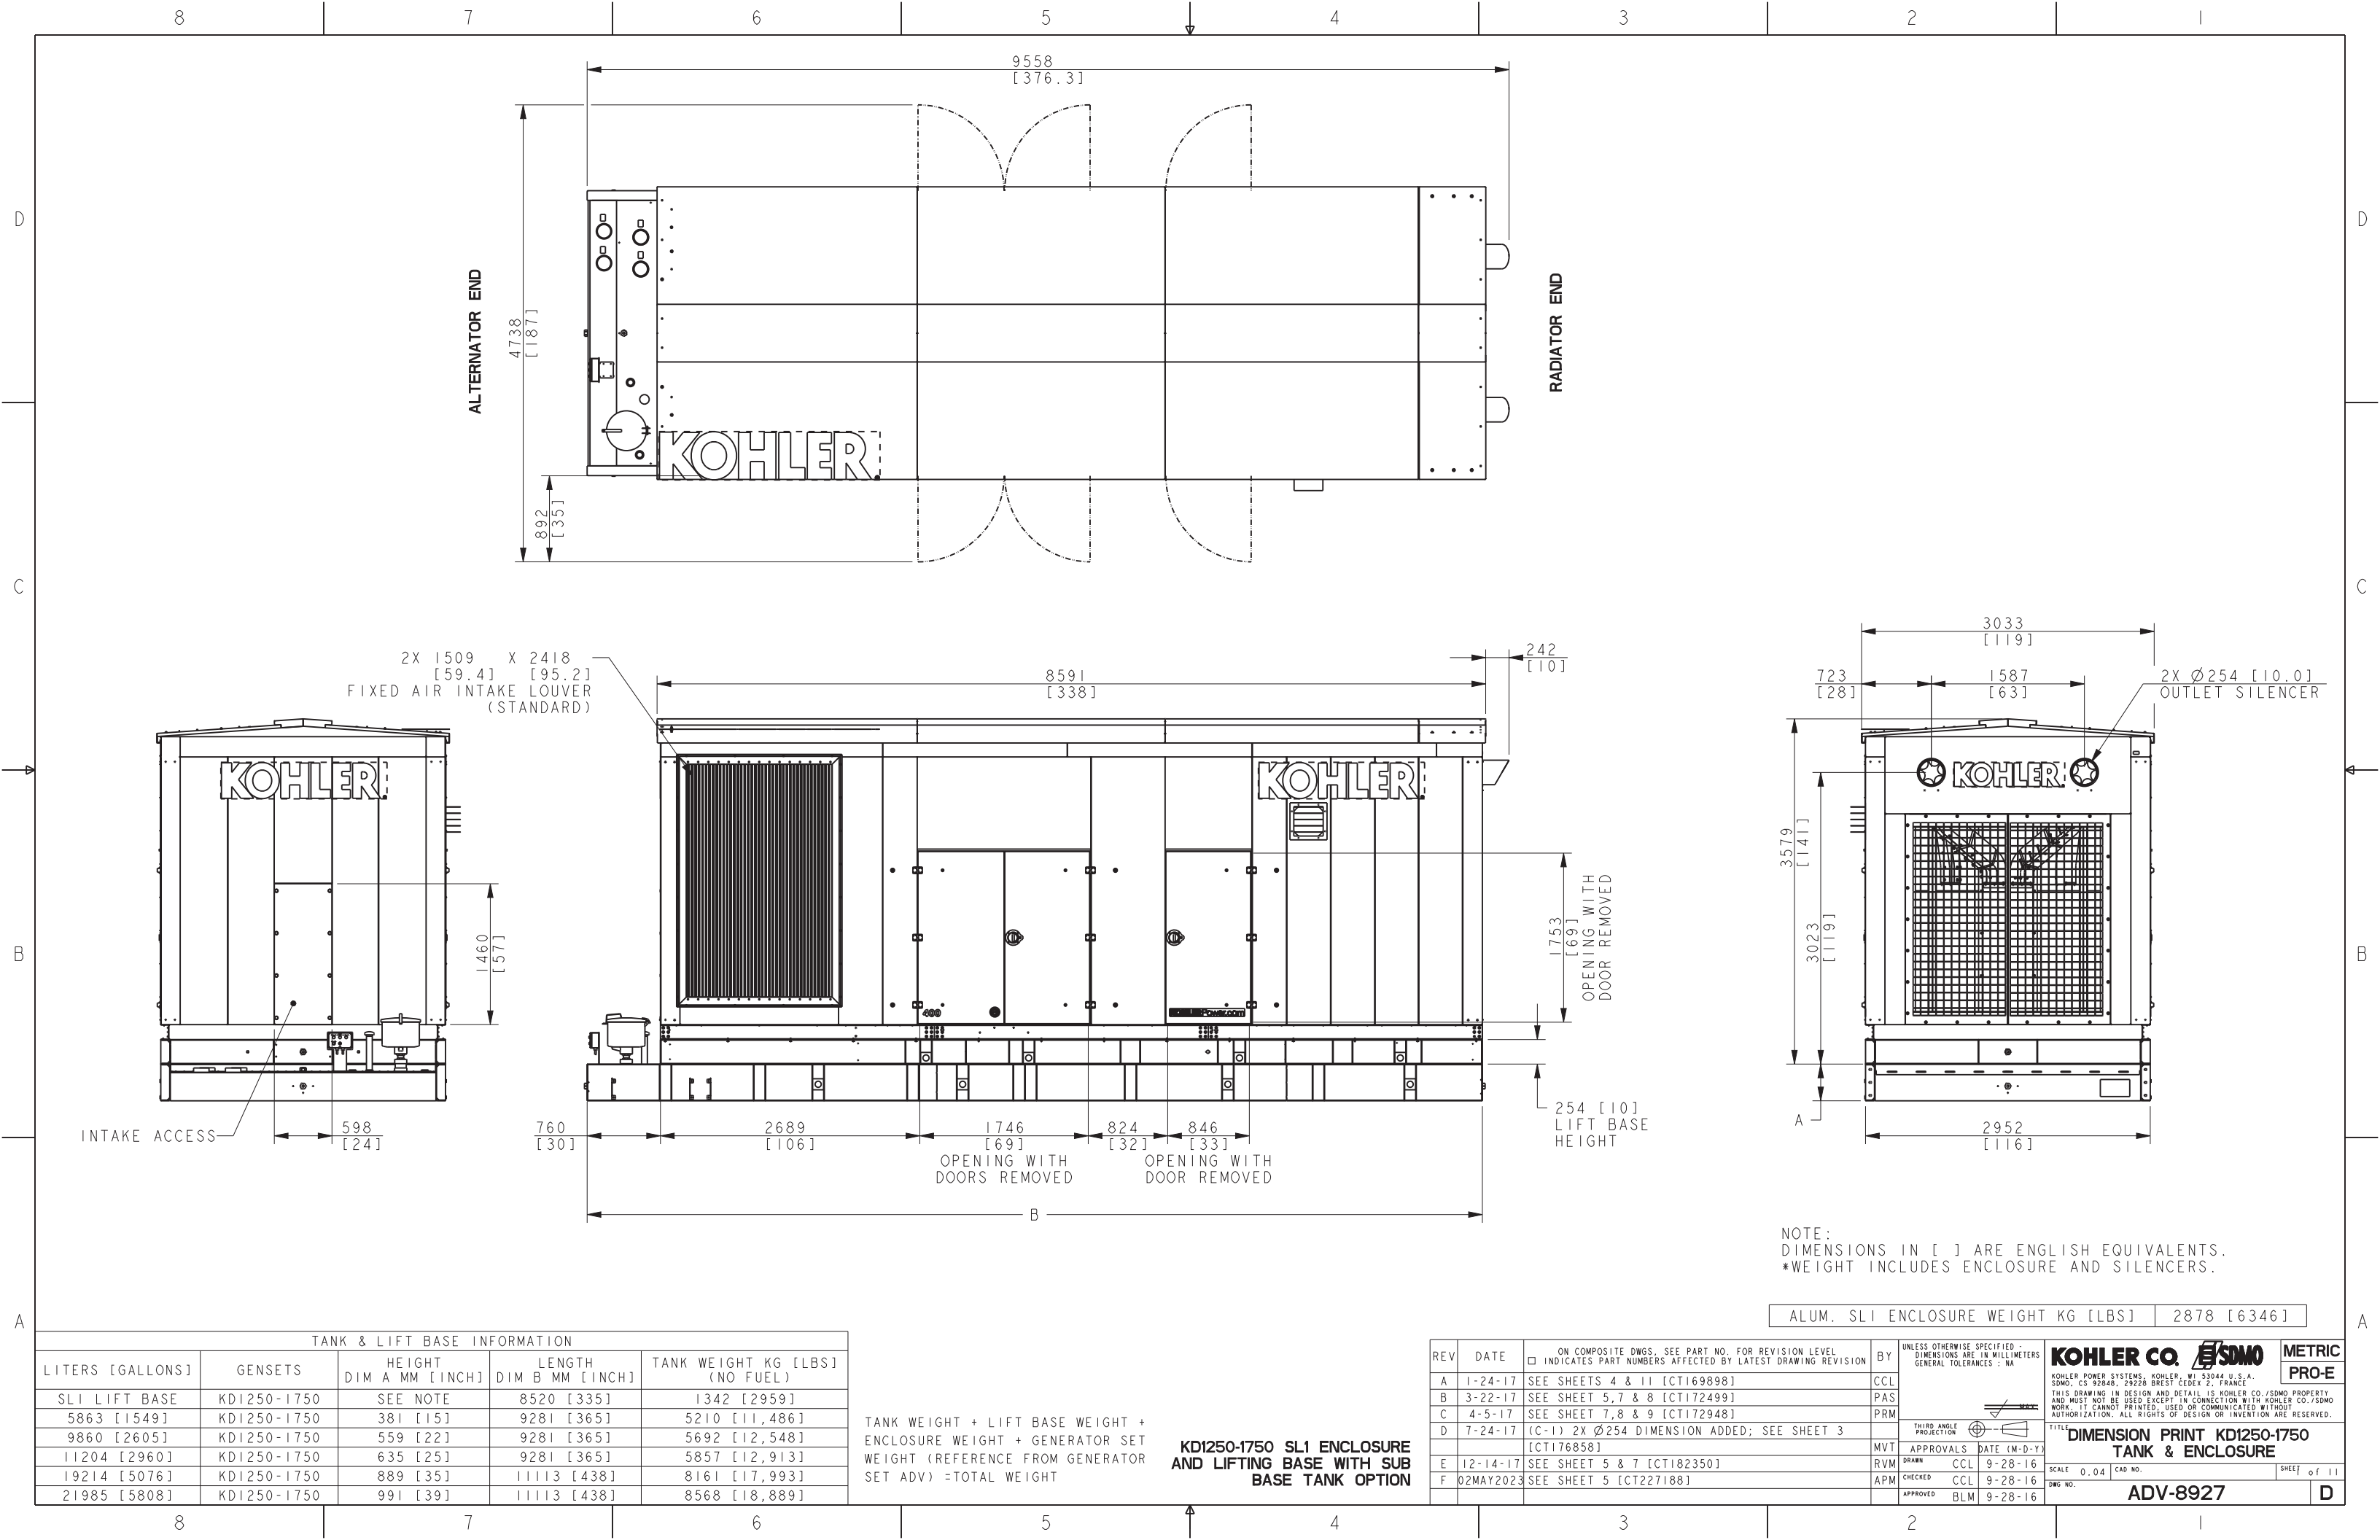

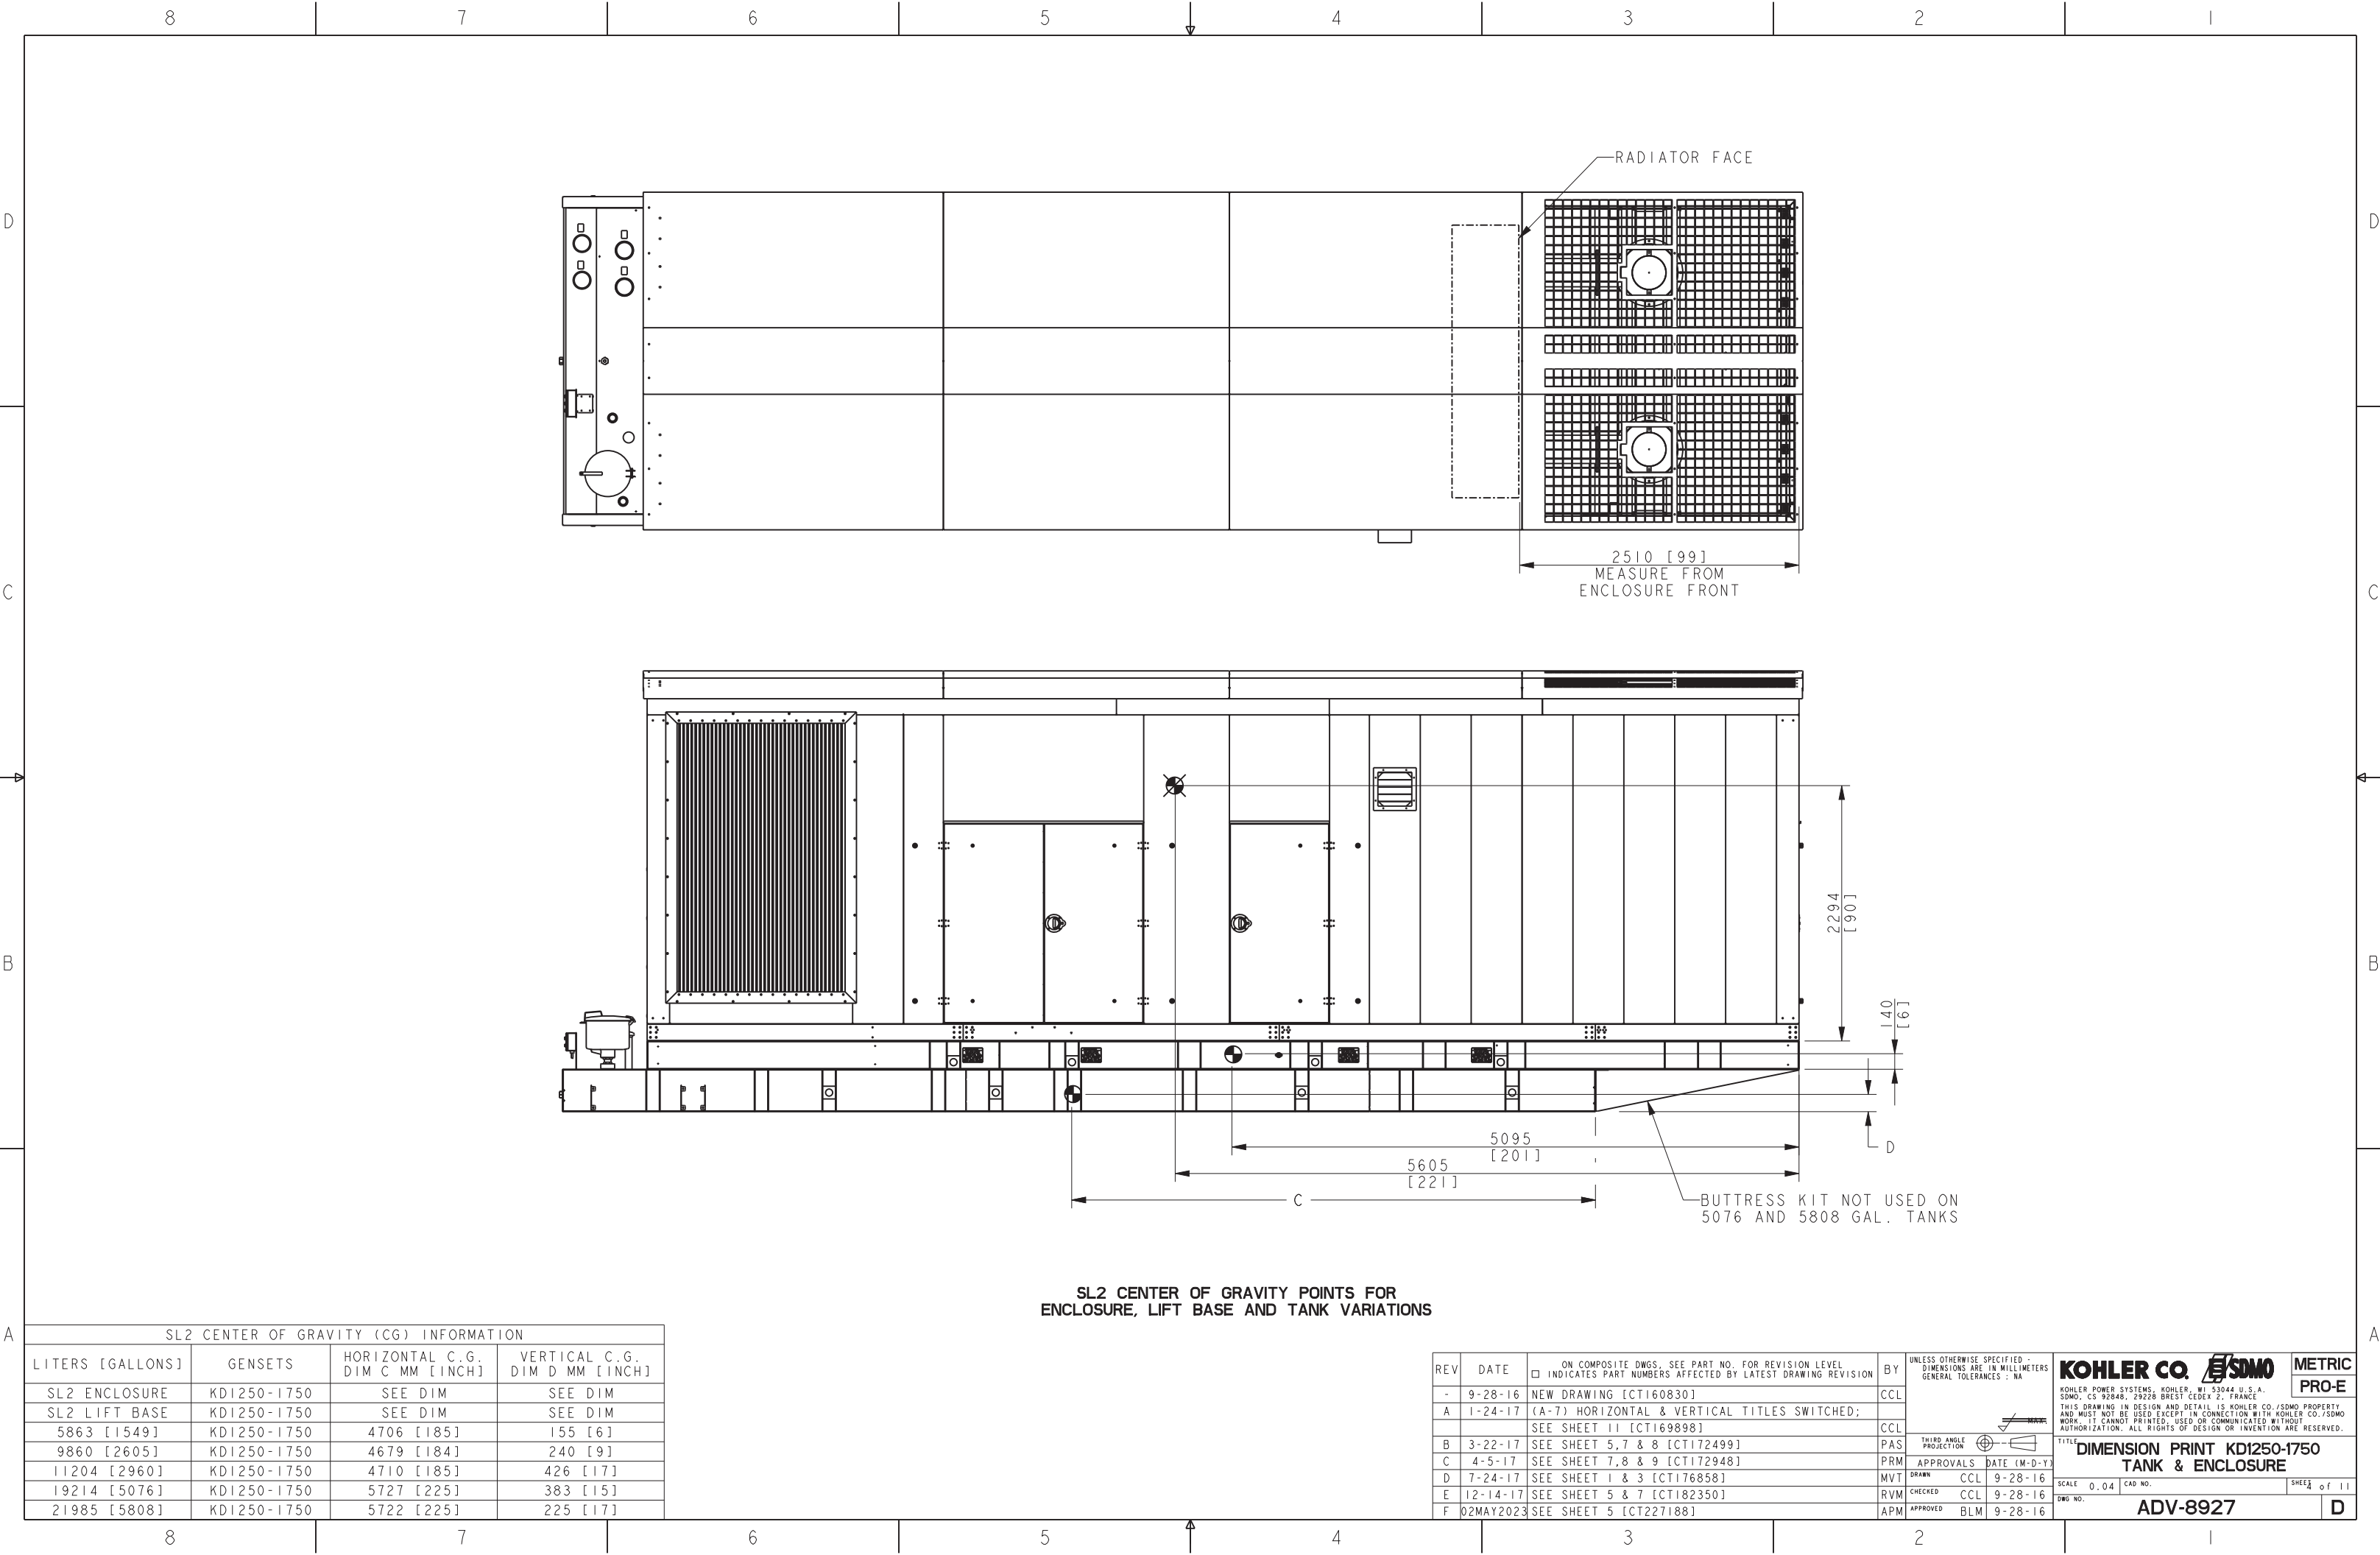


SL2 CENTER OF GRAVITY POINTS FOR ENCLOSURE, LIFT BASE AND TANK VARIATIONS

SL2 CENTER OF GRAVITY (CG) INFORMATION			
LITERS [GALLONS]	GENSETS	HORIZONTAL C.G. DIM C MM [INCH]	VERTICAL C.G. DIM D MM [INCH]
SL2 ENCLOSURE	KDI250-1750	SEE DIM	SEE DIM
SL2 LIFT BASE	KDI250-1750	SEE DIM	SEE DIM
5863 [1549]	KDI250-1750	4706 [185]	155 [6]
9860 [2605]	KDI250-1750	4679 [184]	240 [9]
11204 [2960]	KDI250-1750	4710 [185]	426 [17]
19214 [5076]	KDI250-1750	5727 [225]	383 [15]
21985 [5808]	KDI250-1750	5722 [225]	225 [17]

REV	DATE	ON COMPOSITE DWGS, SEE PART NO. FOR REVISION LEVEL □ INDICATES PART NUMBERS AFFECTED BY LATEST DRAWING REVISION	BY	UNLESS OTHERWISE SPECIFIED - DIMENSIONS ARE IN MILLIMETERS GENERAL TOLERANCES : NA
-	9-28-16	NEW DRAWING [CTI60830]	CCL	
A	1-24-17	(A-7) HORIZONTAL & VERTICAL TITLES SWITCHED; SEE SHEET 11 [CTI69898]	CCL	
B	3-22-17	SEE SHEET 5, 7 & 8 [CTI72499]	PAS	
C	4-5-17	SEE SHEET 7, 8 & 9 [CTI72948]	PRM	
D	7-24-17	SEE SHEET 1 & 3 [CTI76858]	MVT	
E	12-14-17	SEE SHEET 5 & 7 [CTI82350]	RVM	
F	02MAY2023	SEE SHEET 5 [CT227188]	APM	


THIRD ANGLE PROJECTION	
APPROVALS	DATE (M-D-Y)
CCL	9-28-16
CCL	9-28-16
BLM	9-28-16

KOHLER CO. METRIC PRO-E	
KOHLER POWER SYSTEMS, KOHLER, WI 53044 U.S.A. SDMO, CS 92848, 29228 BREST CEDEX 2, FRANCE THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO./SDMO PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO./SDMO WORK. IT CANNOT BE PRINTED, USED OR COMMUNICATED WITHOUT AUTHORIZATION. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.	
TITLE DIMENSION PRINT KDI250-1750 TANK & ENCLOSURE	
SCALE 0.04	CAD NO.
DWG NO. ADV-8927	
SHEET 1 of 11	

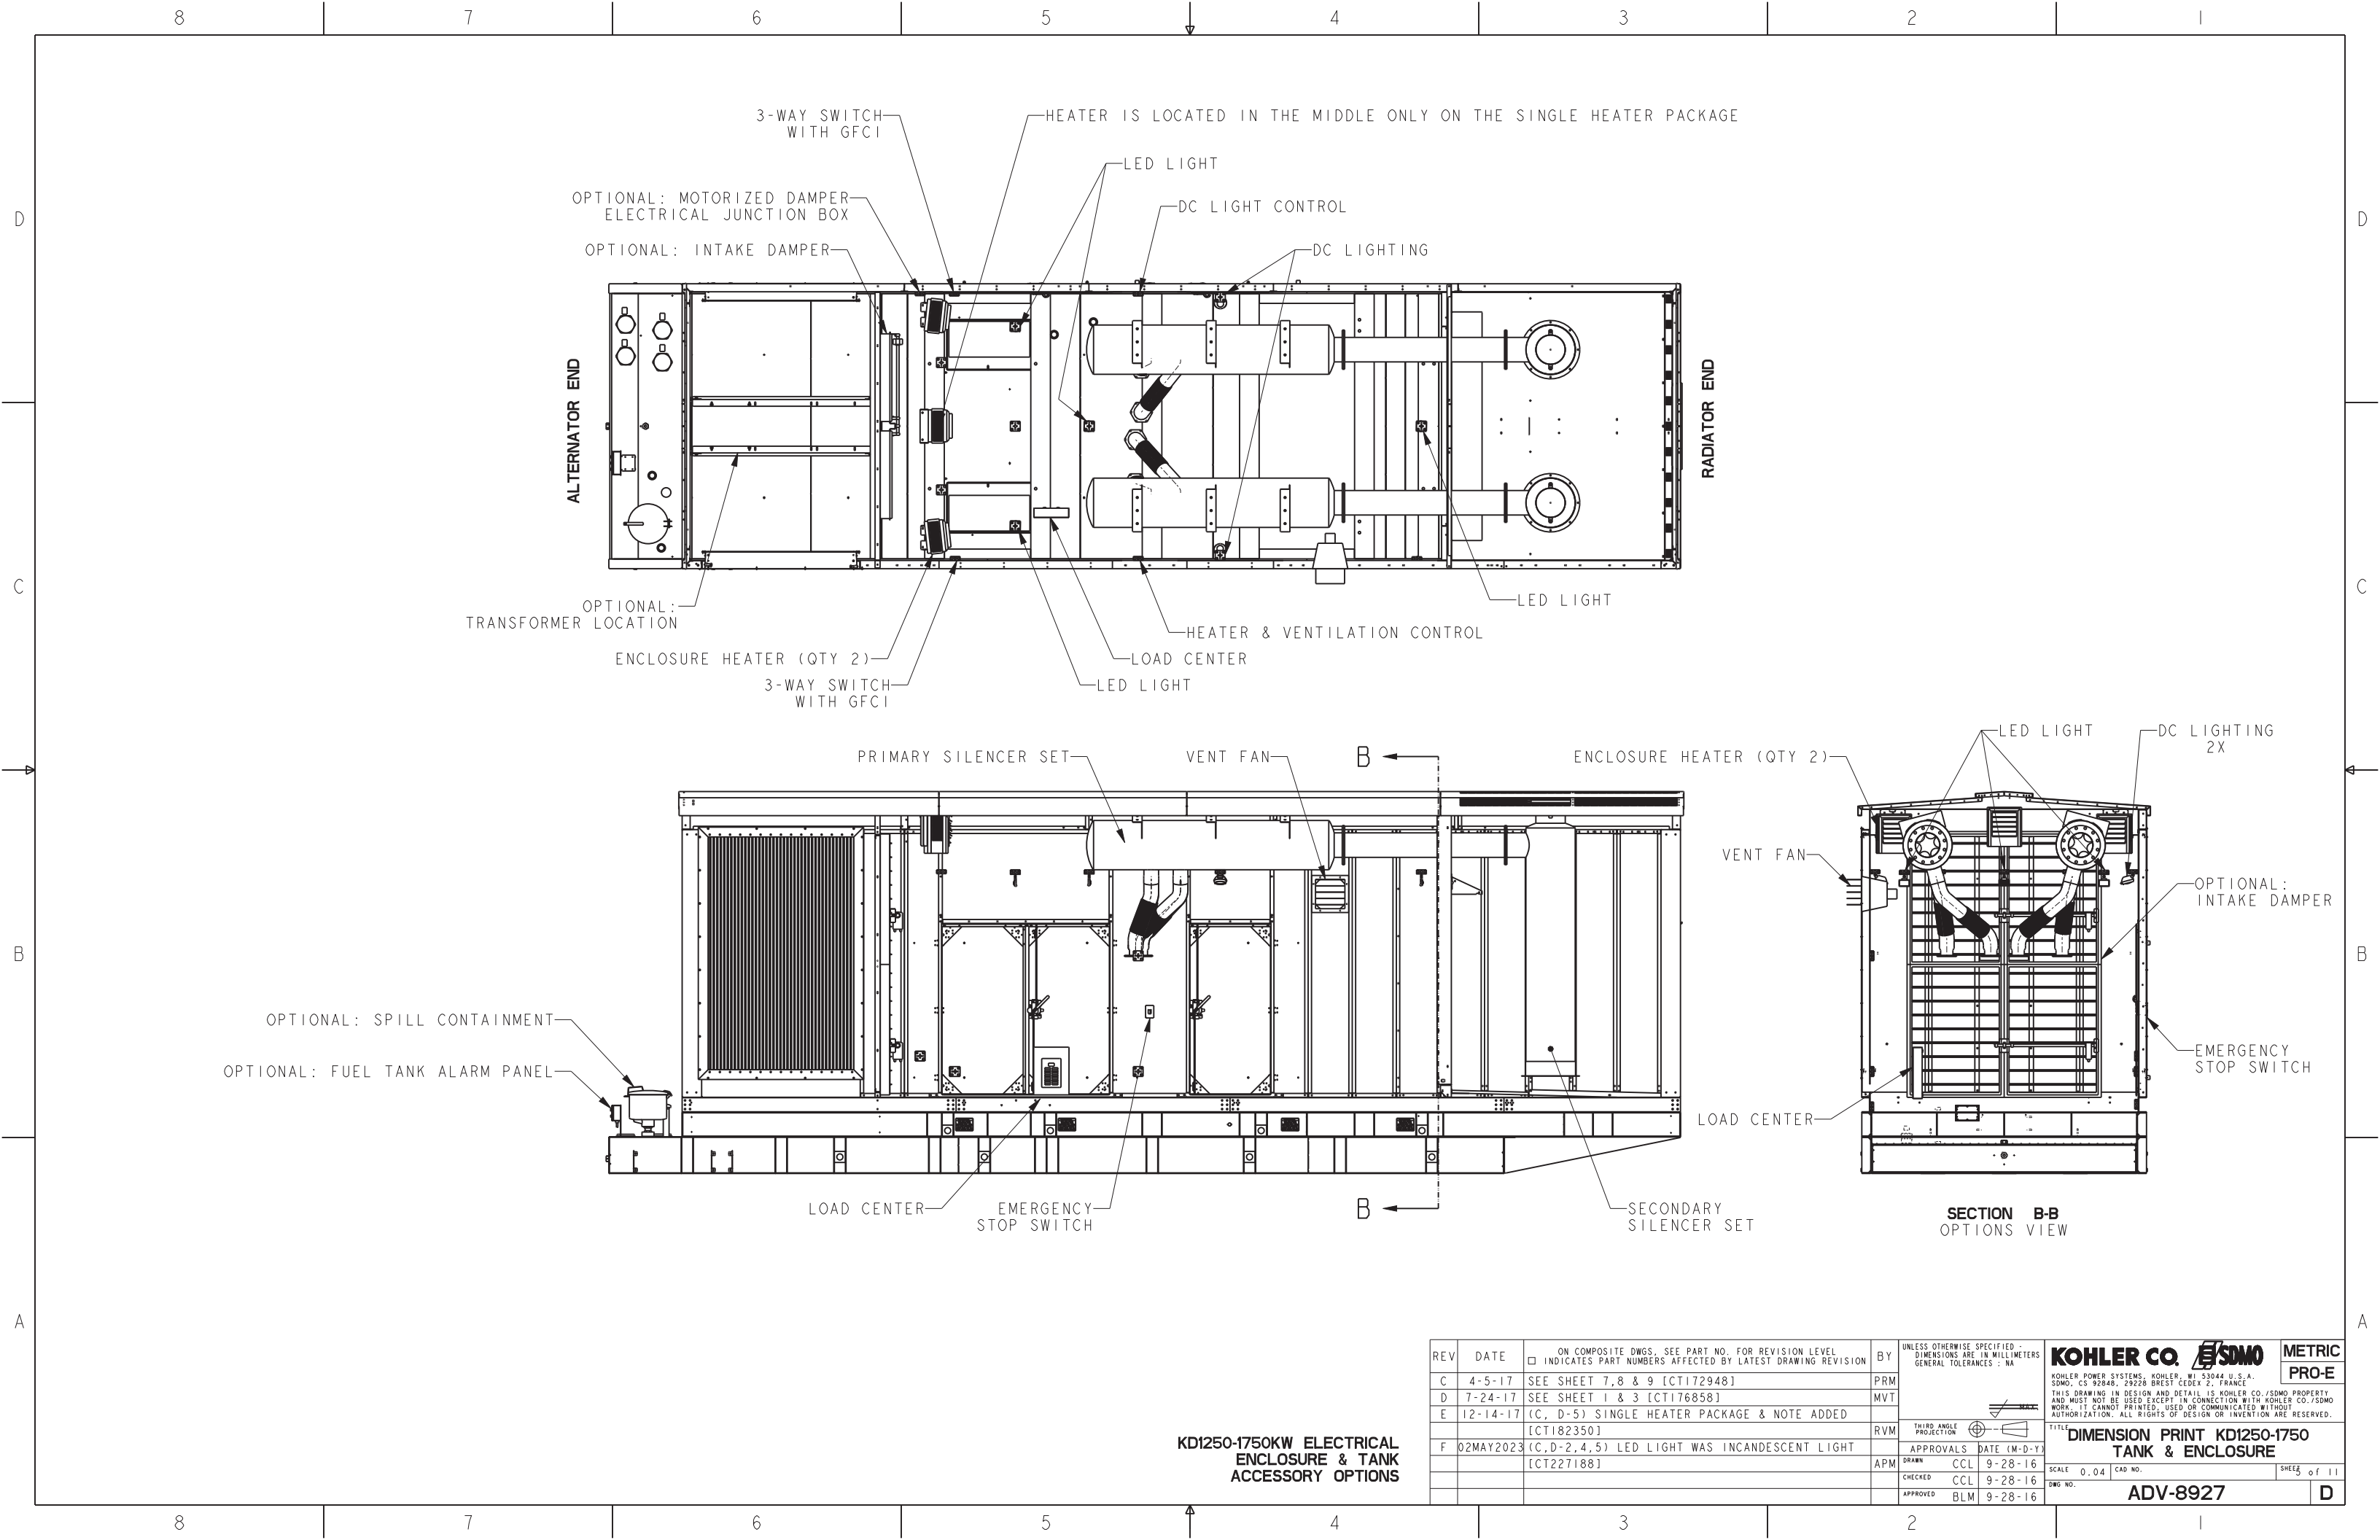

KD1250-1750KW ELECTRICAL
ENCLOSURE & TANK
ACCESSORY OPTIONS


REV	DATE	ON COMPOSITE DWGS, SEE PART NO. FOR REVISION LEVEL □ INDICATES PART NUMBERS AFFECTED BY LATEST DRAWING REVISION	BY	UNLESS OTHERWISE SPECIFIED - DIMENSIONS ARE IN MILLIMETERS GENERAL TOLERANCES : NA	KOHLER CO. METRIC PRO-E
C	4-5-17	SEE SHEET 7, 8 & 9 [CT172948]	PRM		THIRD ANGLE PROJECTION APPROVALS DATE (M-D-Y) DRAWN CCL 9-28-16 CHECKED CCL 9-28-16 APPROVED BLM 9-28-16 TITLE DIMENSION PRINT KD1250-1750 TANK & ENCLOSURE SCALE 0.04 CAD NO. SHEET 5 of 11 DWG NO. ADV-8927
D	7-24-17	SEE SHEET 1 & 3 [CT176858]	MVT		
E	12-14-17	(C, D-5) SINGLE HEATER PACKAGE & NOTE ADDED [CT182350]	RVM		
F	02MAY2023	(C,D-2,4,5) LED LIGHT WAS INCANDESCENT LIGHT [CT227188]	APM		

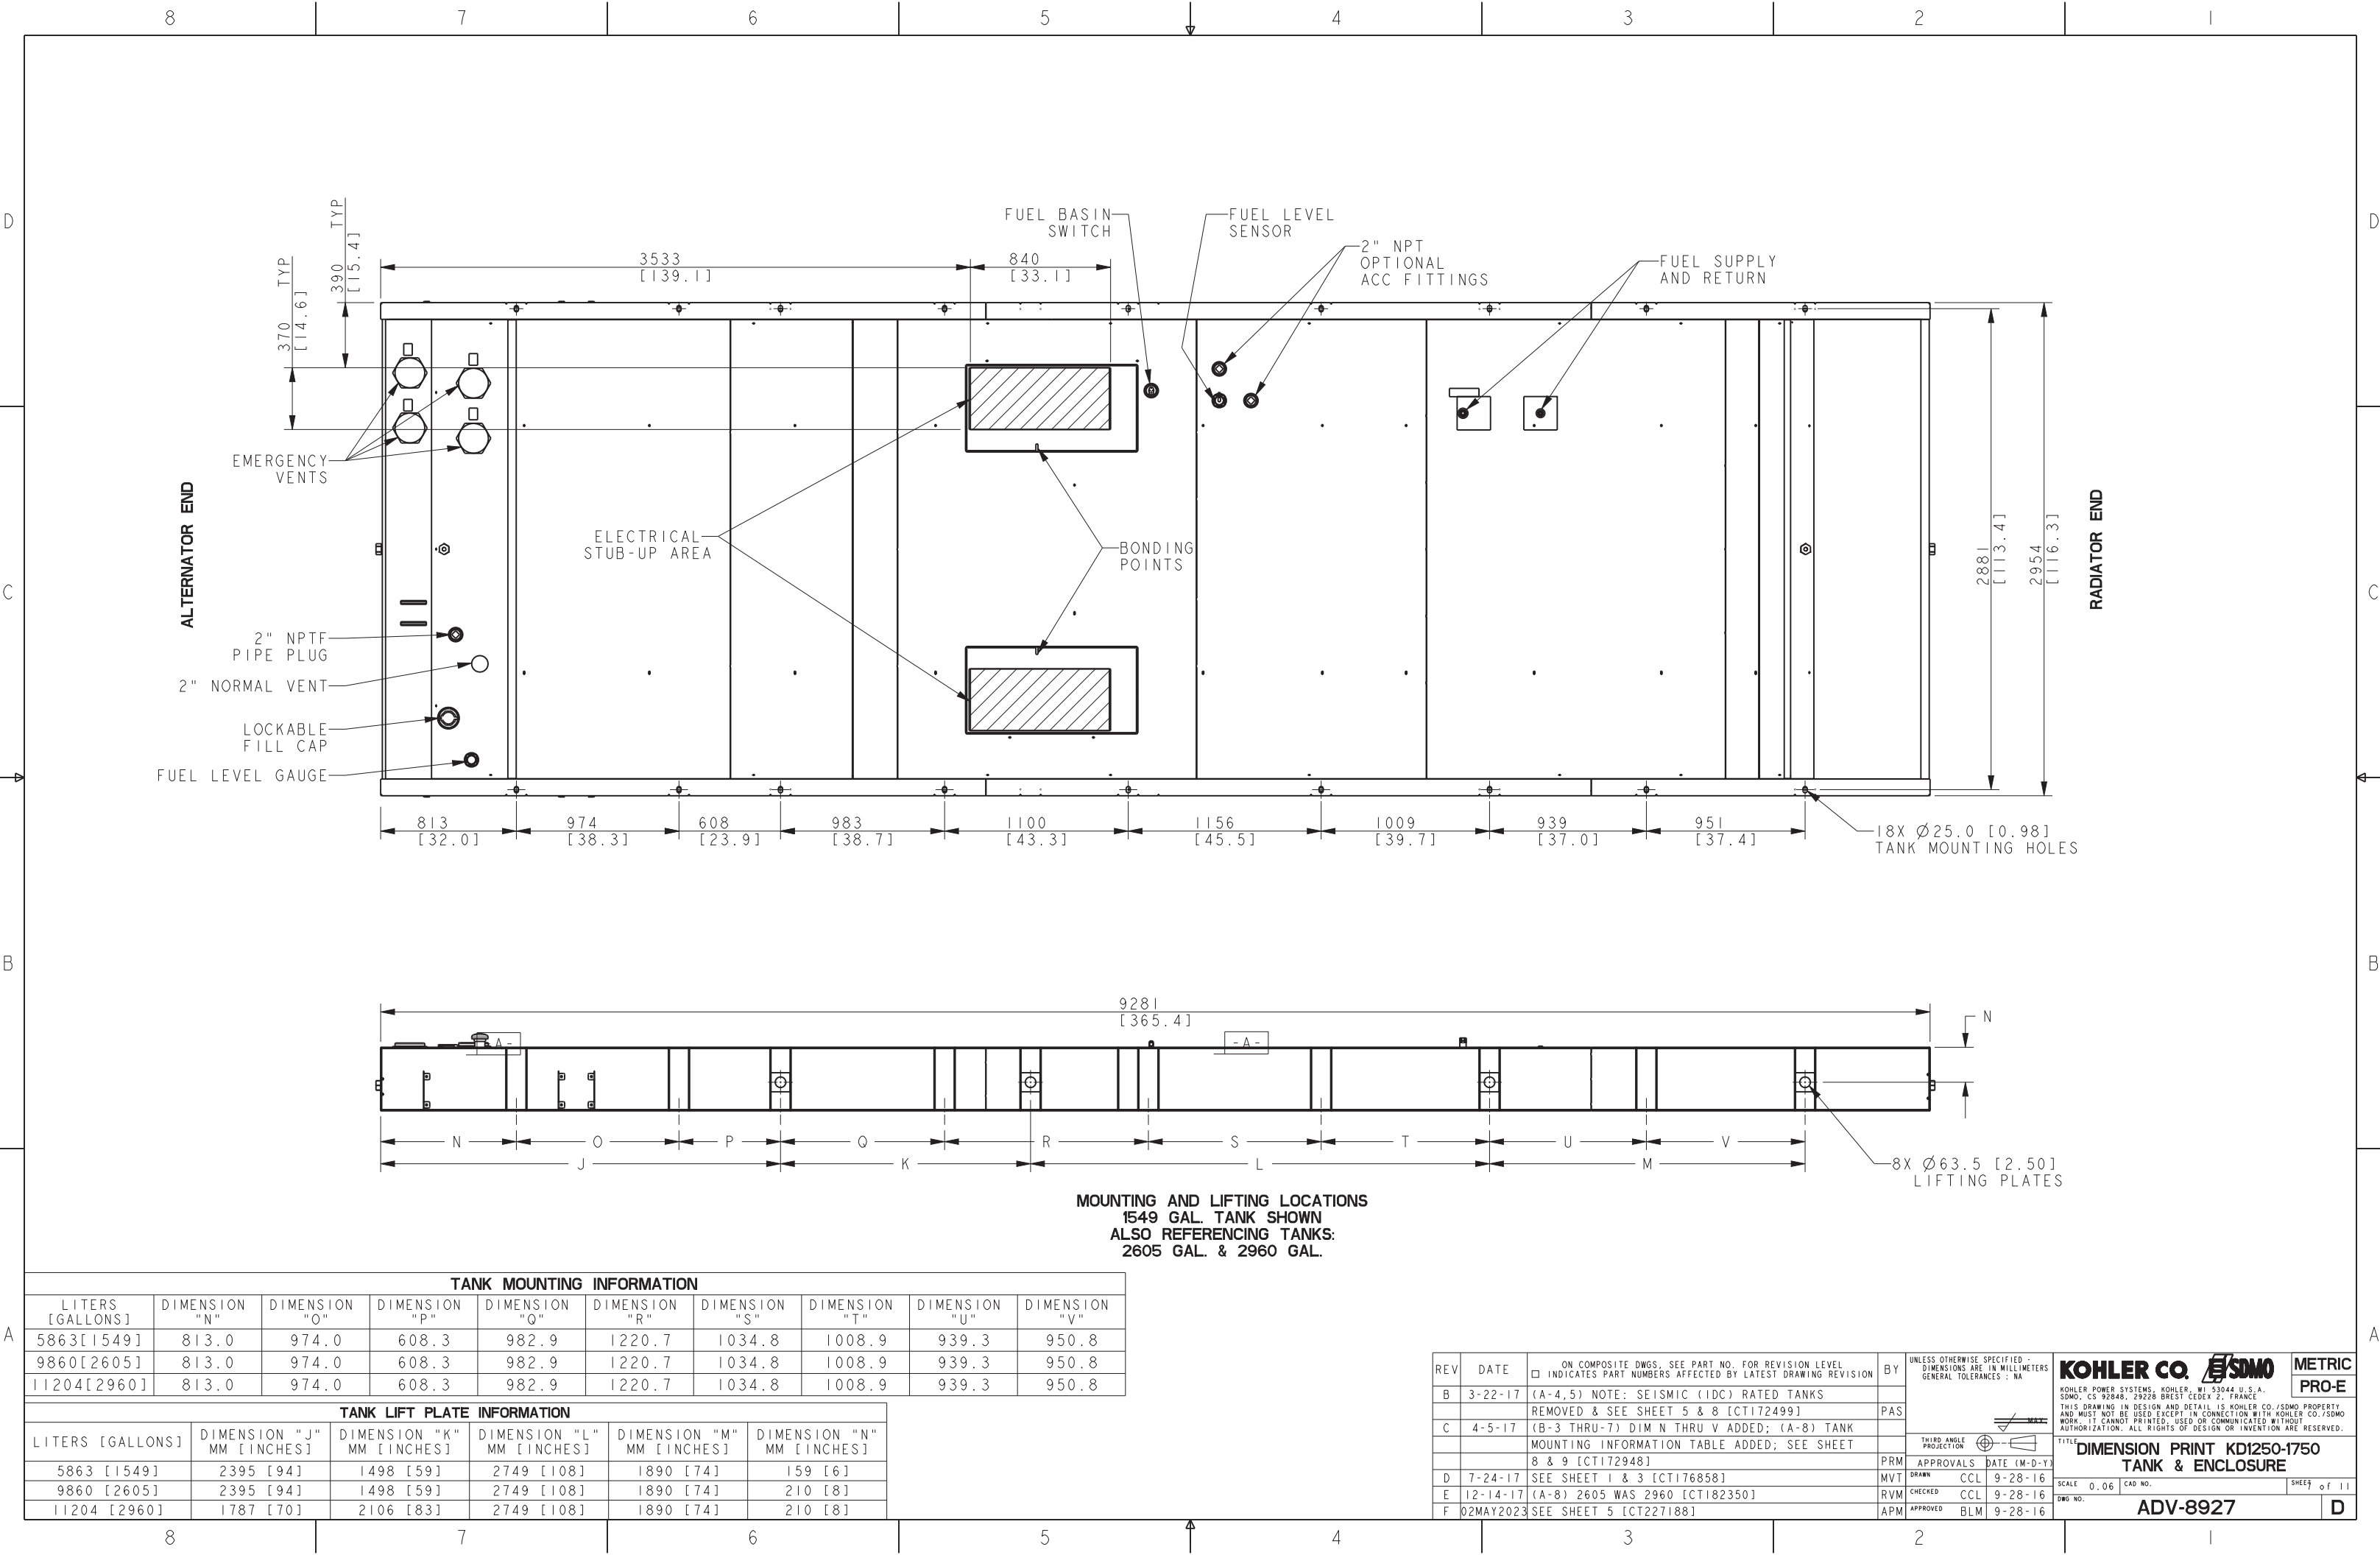

TANK MOUNTING INFORMATION									
LITERS [GALLONS]	DIMENSION "N"	DIMENSION "O"	DIMENSION "P"	DIMENSION "Q"	DIMENSION "R"	DIMENSION "S"	DIMENSION "T"	DIMENSION "U"	DIMENSION "V"
5863[1549]	813.0	974.0	608.3	982.9	1220.7	1034.8	1008.9	939.3	950.8
9860[2605]	813.0	974.0	608.3	982.9	1220.7	1034.8	1008.9	939.3	950.8
11204[2960]	813.0	974.0	608.3	982.9	1220.7	1034.8	1008.9	939.3	950.8

TANK LIFT PLATE INFORMATION					
LITERS [GALLONS]	DIMENSION "J" MM [INCHES]	DIMENSION "K" MM [INCHES]	DIMENSION "L" MM [INCHES]	DIMENSION "M" MM [INCHES]	DIMENSION "N" MM [INCHES]
5863 [1549]	2395 [94]	1498 [59]	2749 [108]	1890 [74]	159 [6]
9860 [2605]	2395 [94]	1498 [59]	2749 [108]	1890 [74]	210 [8]
11204 [2960]	1787 [70]	2106 [83]	2749 [108]	1890 [74]	210 [8]


REV	DATE	ON COMPOSITE DWGS, SEE PART NO. FOR REVISION LEVEL □ INDICATES PART NUMBERS AFFECTED BY LATEST DRAWING REVISION	BY	UNLESS OTHERWISE SPECIFIED - DIMENSIONS ARE IN MILLIMETERS GENERAL TOLERANCES : NA	KOHLER CO.  SDMO KOHLER POWER SYSTEMS, KOHLER, WI 53044 U.S.A. SDMO, CS 92848 29228 BREIST CEDEX 2, FRANCE THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO./SDMO PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO./SDMO WORK. IT CANNOT BE PRINTED, USED OR COMMUNICATED WITHOUT AUTHORIZATION. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.		METRIC PRO-E
B	3-22-17	(A-4,5) NOTE: SEISMIC (IDC) RATED TANKS REMOVED & SEE SHEET 5 & 8 [CT172499]	PAS				TITLE DIMENSION PRINT KD1250-1750 TANK & ENCLOSURE
C	4-5-17	(B-3 THRU-7) DIM N THRU V ADDED; (A-8) TANK MOUNTING INFORMATION TABLE ADDED; SEE SHEET 8 & 9 [CT172948]					
D	7-24-17	SEE SHEET 1 & 3 [CT176858]	PRM	APPROVALS	DATE (M-D-Y)	SCALE 0.06 CAD NO. DWG NO. ADV-8927	
E	12-14-17	(A-8) 2605 WAS 2960 [CT182350]	MVT	DRAWN	CCL 9-28-16		
F	02MAY2023	SEE SHEET 5 [CT227188]	RVM	CHECKED	CCL 9-28-16		D
			APM	APPROVED	BLM 9-28-16		

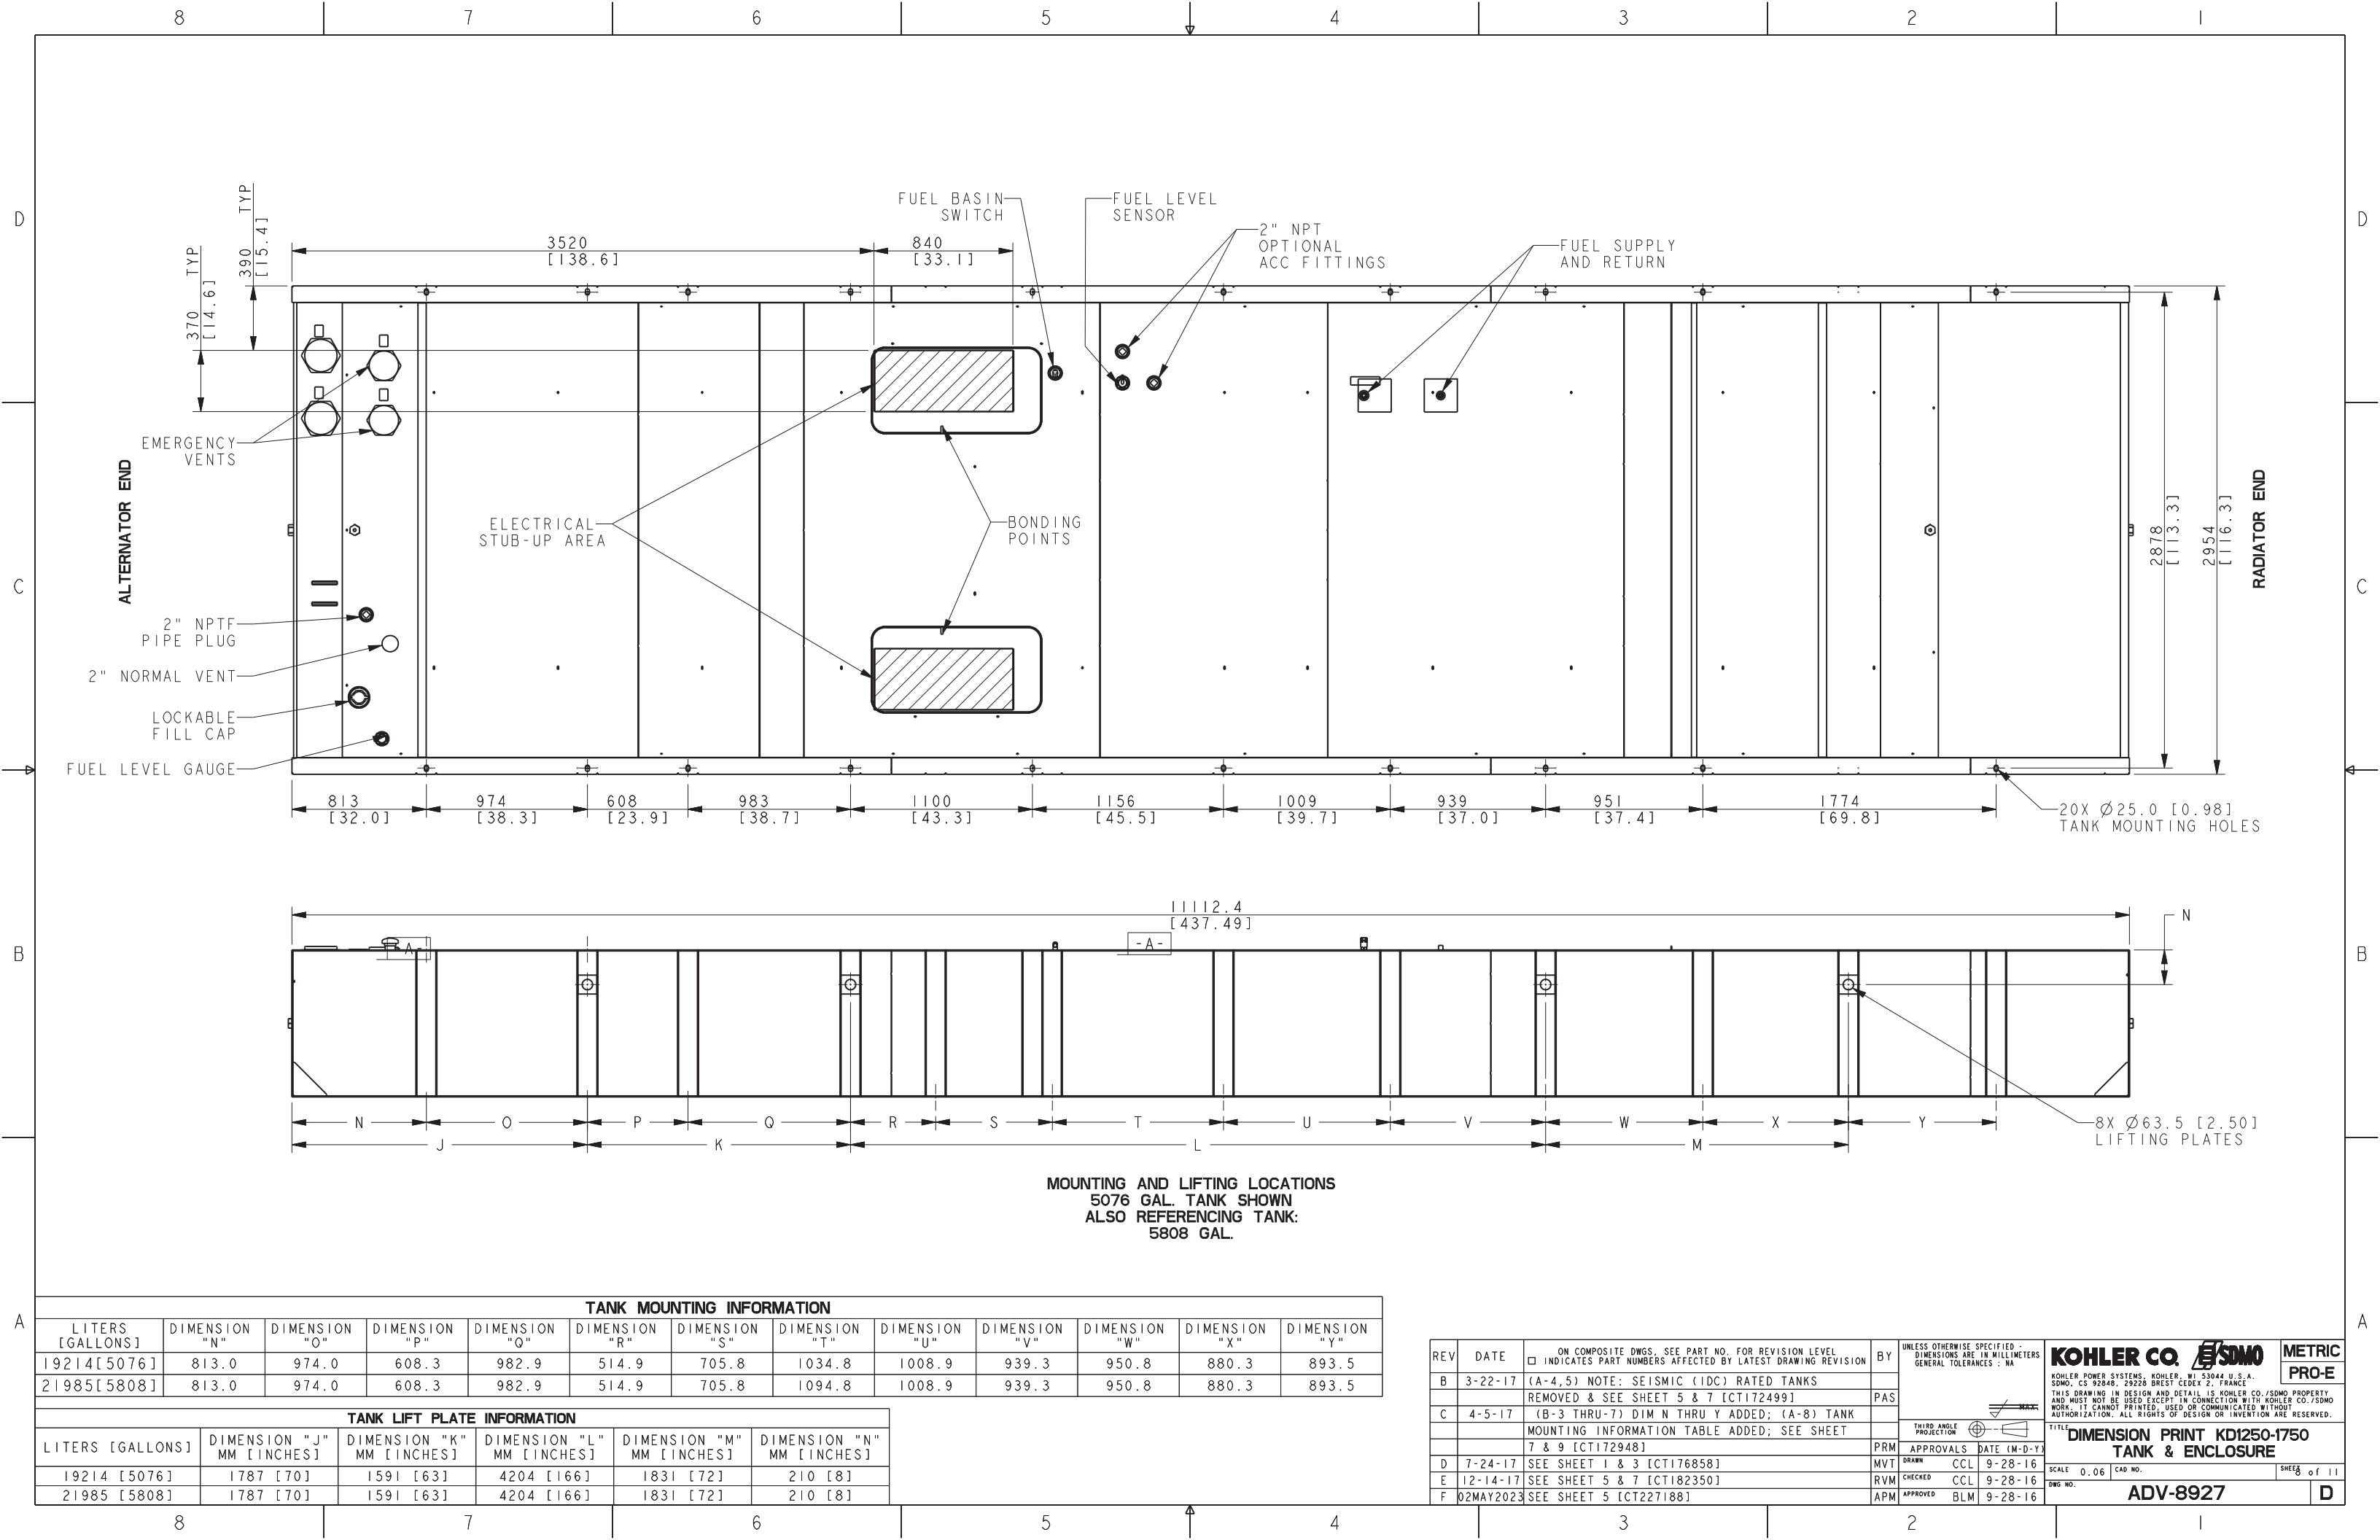

TANK MOUNTING INFORMATION												
LITERS [GALLONS]	DIMENSION "N"	DIMENSION "O"	DIMENSION "P"	DIMENSION "Q"	DIMENSION "R"	DIMENSION "S"	DIMENSION "T"	DIMENSION "U"	DIMENSION "V"	DIMENSION "W"	DIMENSION "X"	DIMENSION "Y"
19214 [5076]	813.0	974.0	608.3	982.9	514.9	705.8	1034.8	1008.9	939.3	950.8	880.3	893.5
21985 [5808]	813.0	974.0	608.3	982.9	514.9	705.8	1094.8	1008.9	939.3	950.8	880.3	893.5


TANK LIFT PLATE INFORMATION					
LITERS [GALLONS]	DIMENSION "J" MM [INCHES]	DIMENSION "K" MM [INCHES]	DIMENSION "L" MM [INCHES]	DIMENSION "M" MM [INCHES]	DIMENSION "N" MM [INCHES]
19214 [5076]	1787 [70]	1591 [63]	4204 [166]	1831 [72]	210 [8]
21985 [5808]	1787 [70]	1591 [63]	4204 [166]	1831 [72]	210 [8]

REV	DATE	ON COMPOSITE DWGS, SEE PART NO. FOR REVISION LEVEL □ INDICATES PART NUMBERS AFFECTED BY LATEST DRAWING REVISION	BY	UNLESS OTHERWISE SPECIFIED - DIMENSIONS ARE IN MILLIMETERS GENERAL TOLERANCES : NA	KOHLER CO.  METRIC PRO-E
B	3-22-17	(A-4,5) NOTE: SEISMIC (IDC) RATED TANKS REMOVED & SEE SHEET 5 & 7 [CTI72499]	PAS		
C	4-5-17	(B-3 THRU-7) DIM N THRU Y ADDED; (A-8) TANK MOUNTING INFORMATION TABLE ADDED; SEE SHEET 7 & 9 [CTI72948]			TITLE DIMENSION PRINT KD1250-1750 TANK & ENCLOSURE SCALE 0.06 CAD NO. SHEET 8 of 11 DWG NO. ADV-8927
			PRM	THIRD ANGLE PROJECT ON	
D	7-24-17	SEE SHEET 1 & 3 [CTI76858]	MVT	APPROVALS DATE (M-D-Y) DRAWN CCL 9-28-16	
E	12-14-17	SEE SHEET 5 & 7 [CTI82350]	RVM	CHECKED CCL 9-28-16	
F	02MAY2023	SEE SHEET 5 [CT227188]	APM	APPROVED BLM 9-28-16	

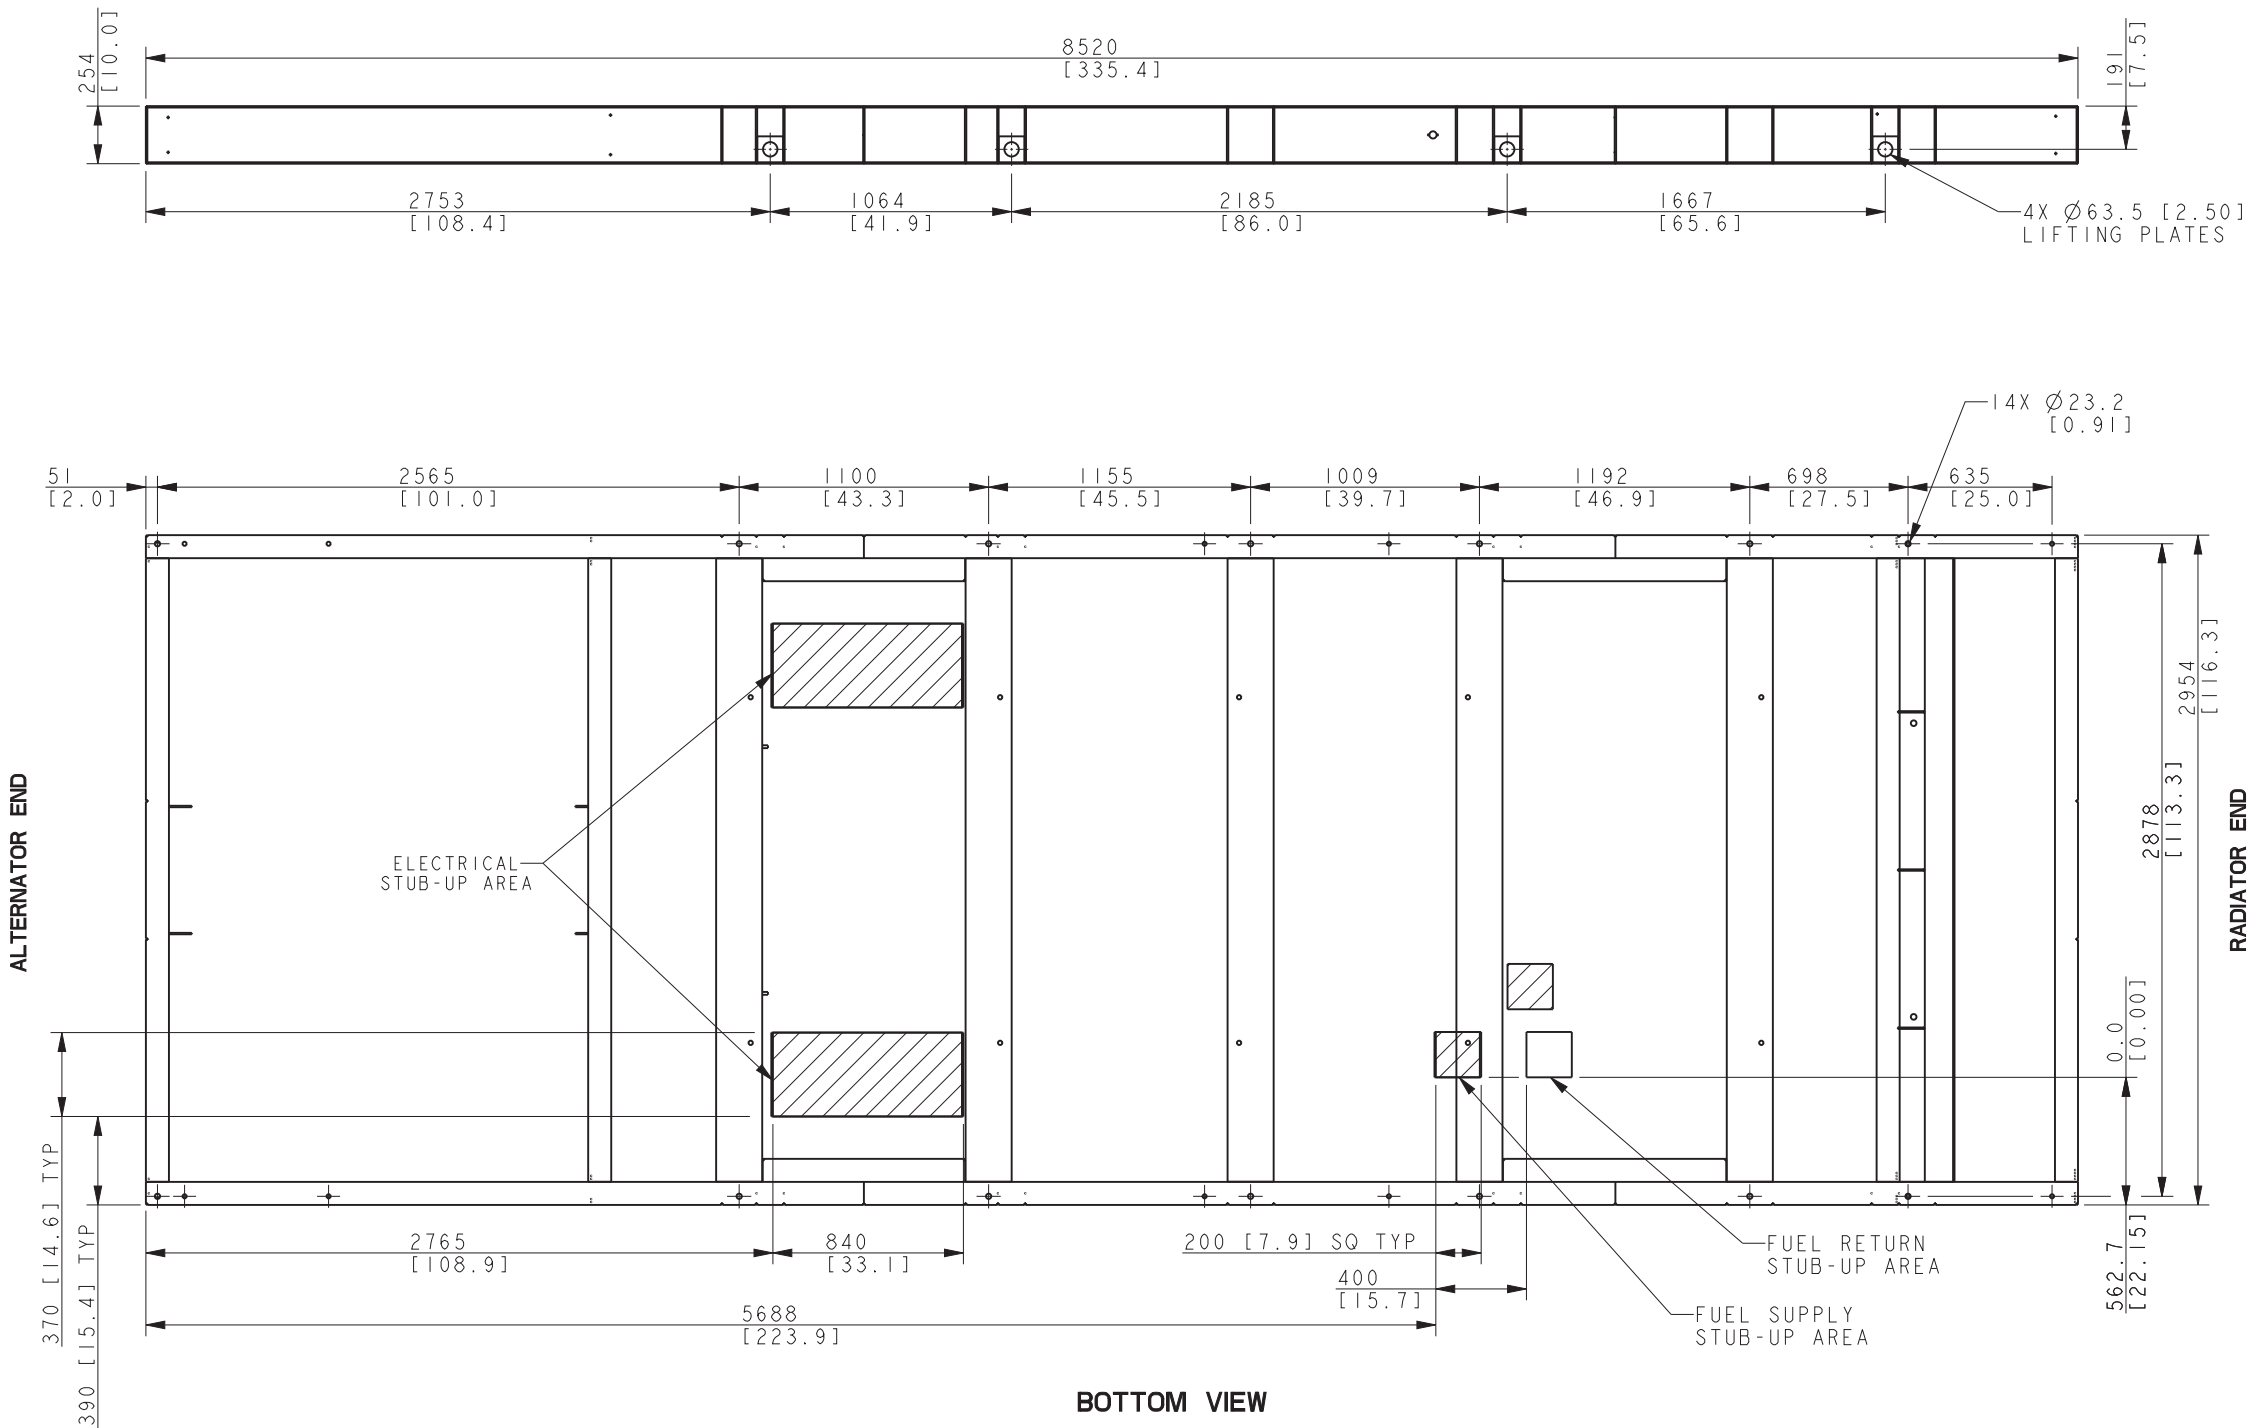

REV	DATE	ON COMPOSITE DWGS, SEE PART NO. FOR REVISION LEVEL □ INDICATES PART NUMBERS AFFECTED BY LATEST DRAWING REVISION	BY	UNLESS OTHERWISE SPECIFIED - DIMENSIONS ARE IN MILLIMETERS GENERAL TOLERANCES : NA	THIRD ANGLE PROJECTION	
-	9-28-16	NEW DRAWING [CTI60830]	CCL			
A	1-24-17	SEE SHEETS 4 & 11 [CTI69898]	CCL			
B	3-22-17	SEE SHEET 5, 7 & 8 [CTI72499]	PAS			
C	4-5-17	(C-2) DIM 635 ADDED; SEE SHEET 7 & 8 [CTI72948]	PRM			
D	7-24-17	SEE SHEET 1 & 3 [CTI76858]	MVT			
E	12-14-17	SEE SHEET 5 & 7 [CTI82350]	RVM	APPROVALS	DATE (M-D-Y)	
F	02MAY2023	SEE SHEET 5 [CT227188]	APM	CHECKED	CCL	9-28-16
				APPROVED	BLM	9-28-16

TITLE		SCALE		CAD NO.	SHEET	of	11
KD1250-1750 SL1 ENCLOSURE LIFTING BASE MOUNTING		0.06					
ADV-8927		D					

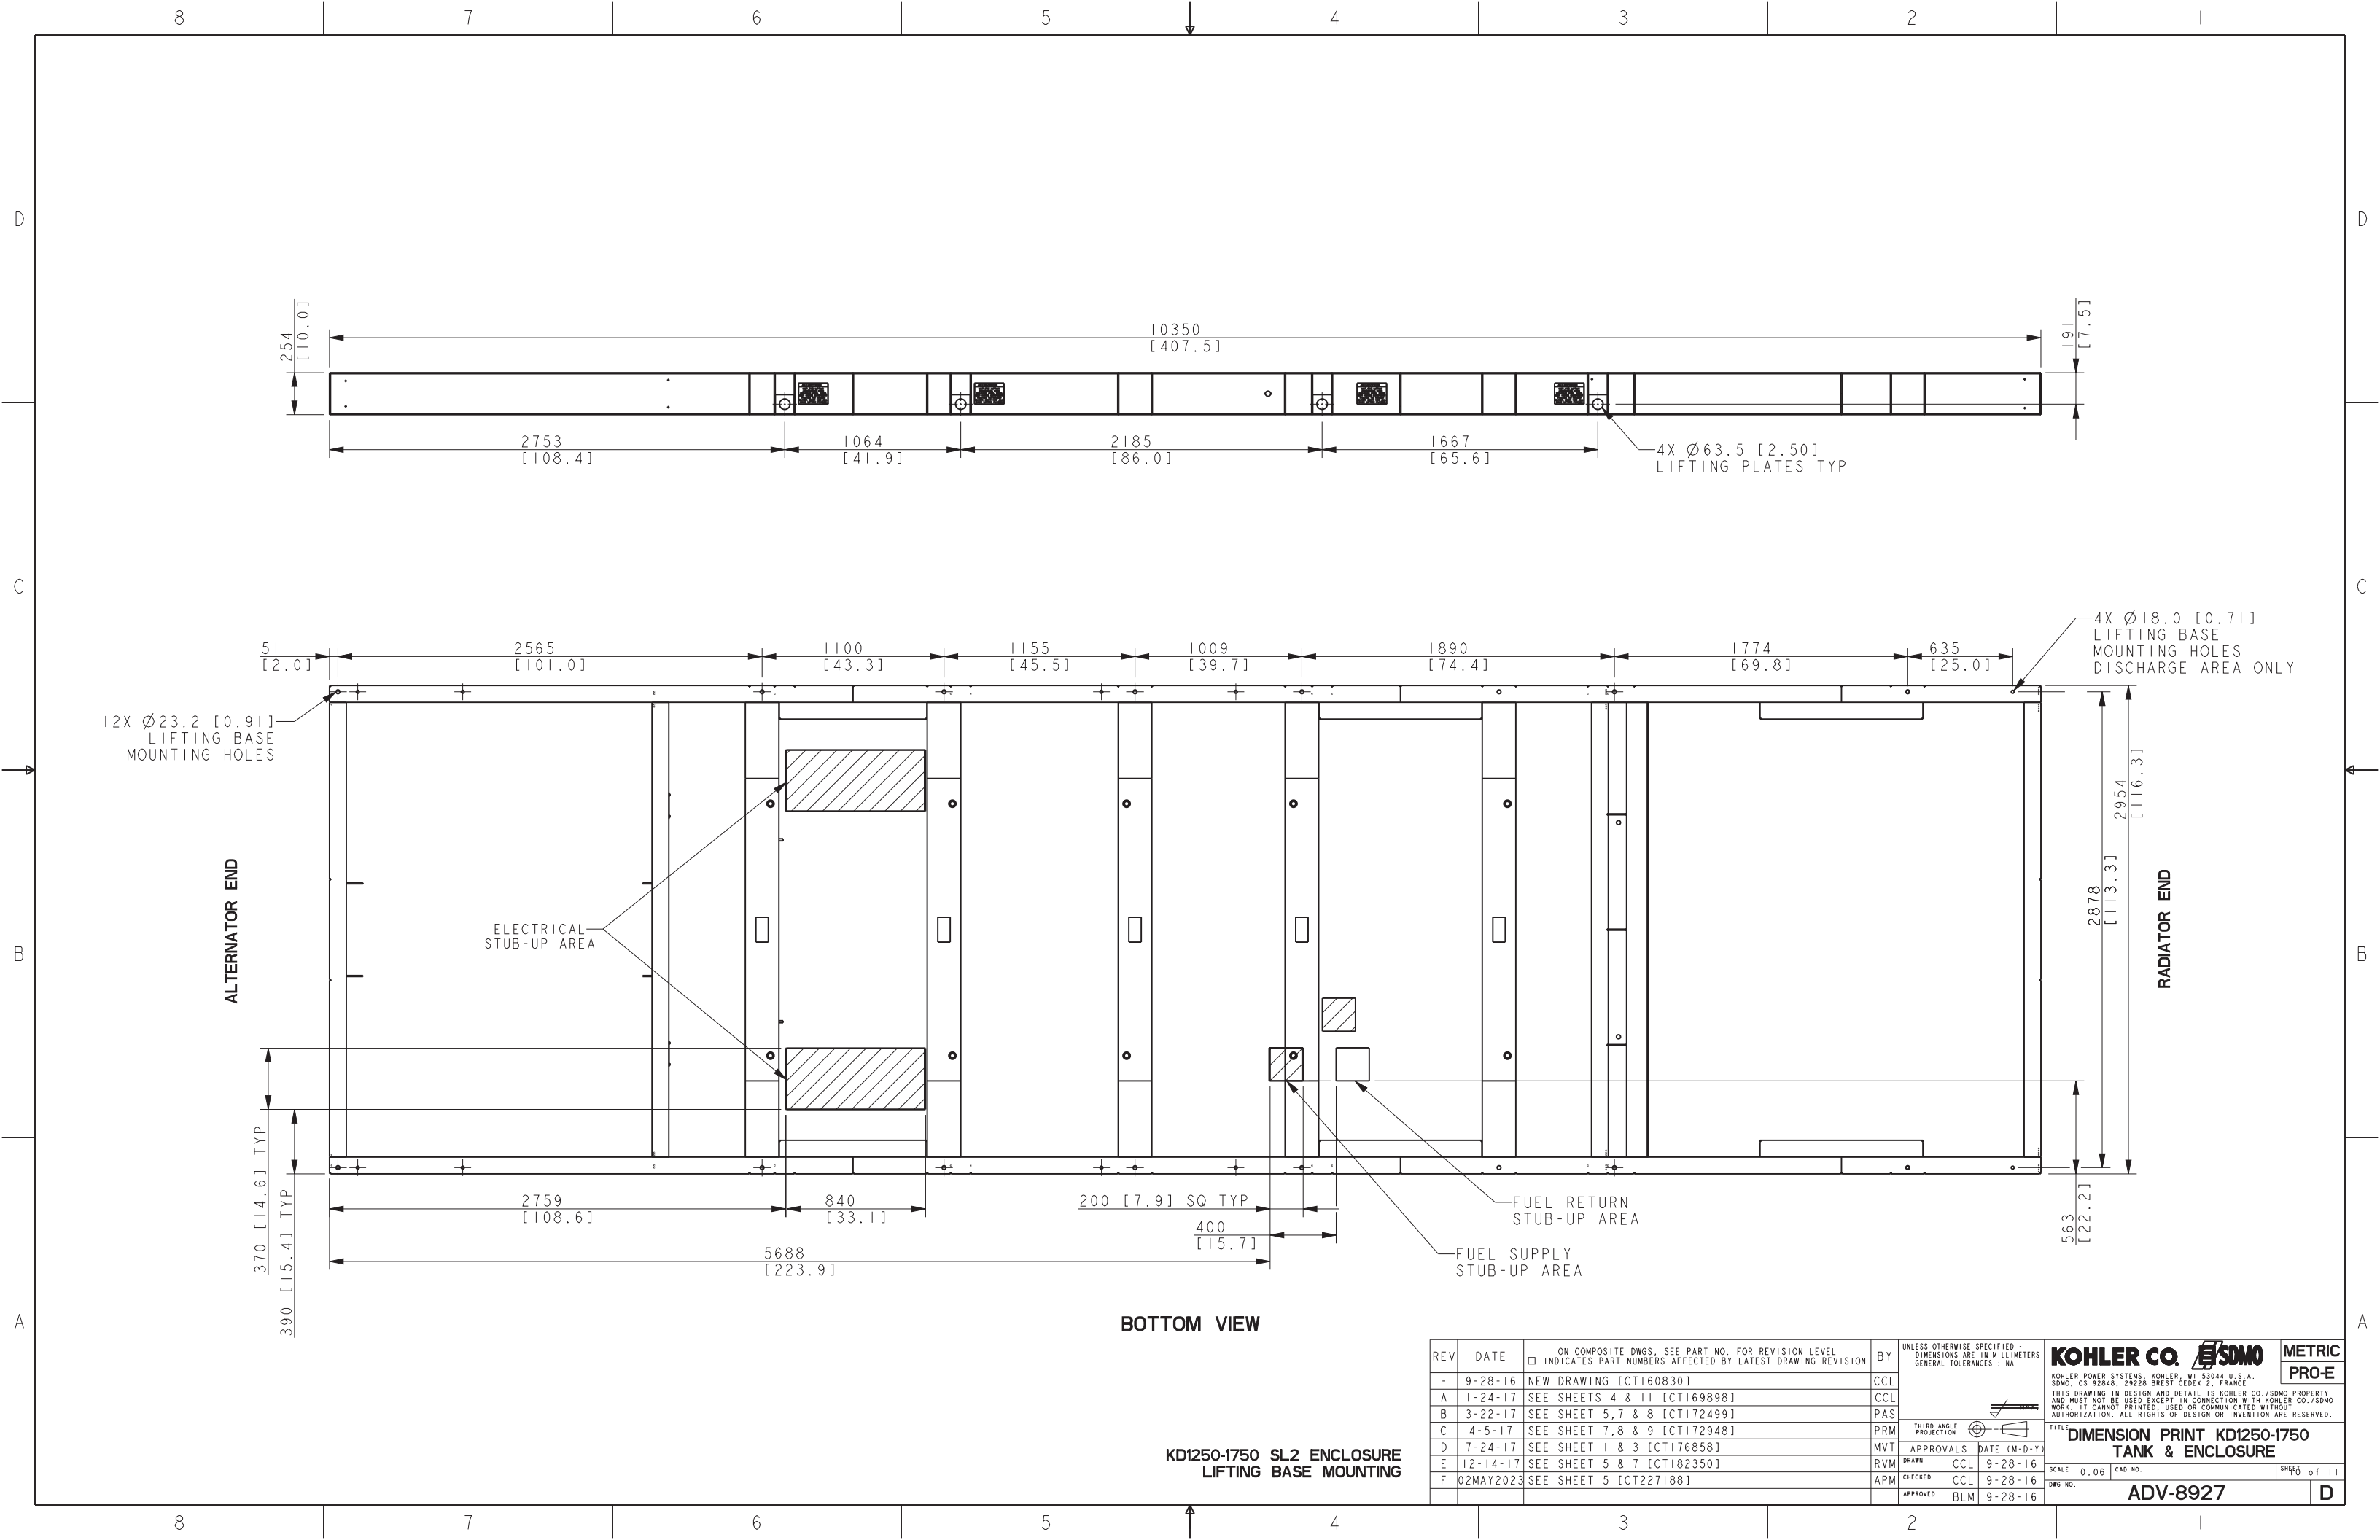

KD1250-1750 SL2 ENCLOSURE
LIFTING BASE MOUNTING

REV	DATE	ON COMPOSITE DWGS, SEE PART NO. FOR REVISION LEVEL □ INDICATES PART NUMBERS AFFECTED BY LATEST DRAWING REVISION	BY	UNLESS OTHERWISE SPECIFIED - DIMENSIONS ARE IN MILLIMETERS GENERAL TOLERANCES : NA	THIRD ANGLE PROJECTION		APPROVALS		DATE (M-D-Y)		TITLE	
-	9-28-16	NEW DRAWING [CTI60830]	CCL								KOHLER CO. METRIC SDMO, CS 92848, 29228 BREST CEDEX 2, FRANCE THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO./SDMO PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO./SDMO WORK. IT CANNOT BE PRINTED, USED OR COMMUNICATED WITHOUT AUTHORIZATION. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.	
A	1-24-17	SEE SHEETS 4 & 11 [CTI69898]	CCL								DIMENSION PRINT KD1250-1750 TANK & ENCLOSURE	
B	3-22-17	SEE SHEET 5, 7 & 8 [CTI72499]	PAS								SCALE 0.06 CAD NO. SHEET 11 of 11	
C	4-5-17	SEE SHEET 7, 8 & 9 [CTI72948]	PRM								ADV-8927	
D	7-24-17	SEE SHEET 1 & 3 [CTI76858]	MVT								D	
E	12-14-17	SEE SHEET 5 & 7 [CTI82350]	RVM									
F	02MAY2023	SEE SHEET 5 [CT227188]	APM									

